IP65 Waterproof Stainless Steel Control Stations High Corrosion and Weather Resistant

The AGS series control stations are designed for mounting various models of switches/pilot lights in various combinations. Standard control stations are available with predetermined specifications of cable lead-in holes and switches/pilot lights mounted (contact configurations, voltage, button colors, and nameplates).

- Wide variety of combinations of switches/pilot lights are possible. Select from a wide variety of ø30 TWN/TWND series switches/pilot lights.
- Buff finish available upon request.



Specifications

Degree of Protection (Note 1)	IP65 (IEC60529) Key selector switch: Splash-proof IP54
Material (Box)	Stainless steel plate (thickness 1 mm)
Coating Color (Melamine coating)	Yellow semi-gloss (Munsell 5Y7/1) 1 column: Outside only 2 or 3 column: Both inside and outside
Rated Insulation Voltage	600V
Insulation Resistance	5 M Ω minimum (500V DC megger)
Dielectric Strength (Note 2)	Between live and dead parts: 2500V AC, 1 minute
Standard Operating Conditions	Ambient temperature: –25 to +50°C (no freezing) Relative humidity: 45 to 85% (no condensation)
Enclosure Style	1 to 5 holes × 1 column, 3 to 5 holes × 2 or 3 columns Wall mount/Pole mount
Cable Lead-in (Wall Mount)	Reducer bushing (Gland hub also available) G1 (28 mm) 1 to 3 holes × 1 column: G3/4 (22 mm)
Applicable Switches/ Pilot Lights	IDEC ø30 mm TWN/TWND series, AM ammeter (except enclosed type units)

Note 1: Degree of protection depends on the switches/pilot lights mounted on the enclosure.

Note 2: AM ammeter: 2000V AC, 1 minute BUFF #400 finish available.

Switch/Pilot Light Mounting Holes

The holes for mounting switches/pilot lights are 30.5 mm in diameter with an anti-rotation notch. Mounting centers are 50 mm.

Lead-in Fittings (Wall Mount)

A reducer bushing made of brass is supplied for connecting a steel conduit to lead in cables.

1 column \times 1 to 3 holes: With one G3/4 for 22 mm conduit 1 column \times 4 or 5 holes: With one G1 for 28 mm conduit 2 columns \times 2 or 3 holes: With two G3/4 for 22 mm conduit 2 columns \times 4 or 5 holes: With two G1 for 28 mm conduit 3 columns \times 2 or 3 holes: With three G3/4 for 22 mm conduit 3 columns \times 4 or 5 holes: With three G1 for 28 mm conduit

Note: Mounting other than standard (e.g. one bushing for 2 column, one or two bushings for 3 column) Is not available. In this case, a plug is supplied.

HNG gland hubs for lead in cables are also available.

Stand Pole (Pole Mount)

The pole is made of carbon steel pipe, and the base is made of cast iron. The coating color is the same as the enclosure, yellow (semi-gloss).



1

Control Stations with Switches/Pilot Lights

The standard control stations are available with selected combinations of switches/pilot lights as listed below. For the dimensions and mounting centers, see the figures on page 4.

Switches/Pilot Lights Mounted on Standard Control Stations					
Switch/Pilot Light	Part No.	Specifications			
	ABN110 *	Flush, 1NO			
Pushbutton	ABN101 *	Flush, 1NC			
PB	ABN111 *	Flush, 1NO-1NC			
	ABN311R	ø40 mushroom, 1NO-1NC			
Pilot Light	APN116DN *	Dome, 100/110V AC (2W)			
🖭 (LED)	APN126DN *	Dome, 200/220V AC (2W)			
Calastar Curitab	ASN211N	Knob, 2-position, 1NO-1NC			
Selector Switch	ASN320N	Knob, 3-position, 2NO			
	ASN2K11N-N024401	Key, 2-position, 1NO-1NC			
Meter (À)	AM ammeter	Round metal Specify capacity (Part No.)			
	AM2B ammeter	Square plastic Specify capacity (Part No.)			

Switches/Pilot Lights Mounted on Standard Control Stations

Note: Specify a button or lens color code in place of * :

Pushbutton: B (black), G (green), R (red) Pilot Light: G (green), R (red)

Flush pushbuttons are supplied with black, green, and red color caps.

1-column Package Quanti					
Con	trol Station		Mounted Switches/Pilot Lights		
Style	Part No.	Symbol	Part No.	NA Nameplate Legend	
	AGS1101MB	PB	ABN110B	ON	
	AGS1102M	PB	ABN311R	OFF	
Wall Mount 1 hole	AGS1103M	P	APN116DNR	Without nameplate	
Wall P 1 h	AGS1105M	SS	ASN211N	HAND-AUTO	
	AGS1106M	S	ASN320N	HAND-OFF-AUTO	
	AGS1107M	S	ASN2K11N-N024401	OFF-ON	
Pole Mount 1 hole	AGS1101SMB	PB	ABN110B	ON	
Pole I 1 h	AGS1102SM	PB	ABN311R	OFF	
	AGS2101MB	PB	ABN110B ABN101R	ON OFF	
	AGS2102MB	BB	ABN111B ABN111R	ON OFF	
	AGS2103M	E	APN116DNR APN116DNG	Without nameplate	
Wall Mount 2 holes	AGS2104M	Þ	APN126DNR APN126DNG	Without nameplate	
Wall N 2 hc	AGS2105MR	Þ	APN116DNR ABN111R	Without nameplate STOP	
	AGS2106MR	e B	APN126DNR ABN111R	Without nameplate STOP	
	AGS2107M	EØ	APN116DNR ASN211N	Without nameplate HAND-AUTO	
	AGS2108M	23	APN126DNR ASN211N	Without nameplate HAND-AUTO	

Con	trol Station	Mounted Switches/Pilot Lights			
Style	Part No.	Symbol	Part No.	NA Nameplate Legend	
l Mount holes	AGS2110M	PL SS	APN126DNR ASN2K11N-N024401	Without nameplate OFF-ON	
Wall Mount 2 holes	AGS2113MB	PB PB	ABN110B ABN311R	ON OFF	
Pole Mount 2 holes	AGS2101SMB	PB PB	ABN110B ABN101R	ON OFF	
Pole I 2 h	AGS2107SM	PL SS	APN116DNR ASN211N	Without nameplate HAND-AUTO	
	AGS3102MB	P B B	APN116DNR ABN110B ABN101R	Without nameplate ON OFF	
Wall Mount 3 holes	AGS3103MB	e B B	APN126DNR ABN110B ABN101R	Without nameplate ON OFF	
	AGS3104MB	B B S	ABN111B ABN111R ASN211N	ON OFF HAND-AUTO	
Pole Mount 3 holes	AGS3102SMB	e B B	APN116DNR ABN110B ABN101R	Without nameplate ON OFF	
Pole n 3 h	AGS3104SMB	BBS	ABN111B ABN111R ASN211N	ON OFF HAND-AUTO	
	Wall Mount AGS4101B	E C B	APN126DNR APN126DNG	Without nameplate Without nameplate	
	Pole Mount AGS4101SB	PB	ABN111B ABN111R	ON OFF	
	Wall Mount AGSM4101B	A	(Note) AM ammeter ABN111B	Without nameplate ON	
Wall-Pole 4 holes	Pole Mount AGSM4101SB	PB PB	ABN111R	OFF	
Wal 4 I	Wall Mount AGSM4102	A	(Note) AM2B ammeter	Without nameplate	
	Pole Mount AGSM4102S	PB PB	ABN111B ABN111R	ON OFF	
	Wall Mount AGS4102B	P	APN126DNR ABN111B	Without nameplate ON	
	Pole Mount AGS4102SB	PB SS	ABN111R ASN211N	OFF Hand-Auto	
	Wall Mount AGS5101B	E E B B S	APN126DNR APN126DNG ABN111B	Without nameplate Without nameplate ON	
	Pole Mount AGS5101SB) B SS	ABN111R ASN211N	OFF HAND-AUTO	
Wall-Pole 5 holes	Wall Mount AGSM5101B	A PL	(Note) AM ammeter APN126DNR	Without nameplate Without nameplate	
Wa 5	Pole Mount AGSM5101SB	P P B B	ABN111B ABN111R	ON OFF	
	Wall Mount AGSM5102	A	(Note) AM2B ammeter APN126DNR	Without nameplate Without nameplate	
	Pole Mount AGSM5102S	P B B	ABN111B ABN111R	ON OFF	

Note: Specify the Part No. of the meter to select a required capacity.

2

AGS Series Control Statio	ns
---------------------------	----

2-column		Package Quantity: 1				
Control Station		Mounted Switches/Pilot Lights				
Style	Part No.	Symbol	Part No.	NA Nameplate Legend		
	Wall Mount AGS3801B	(PB (PB) (PB (PB)	ABN111B ABN111R	ON OFF		
Wall-Pole 3 holes	Pole Mount AGS3801SB	88	ASN211N	HAND-AUTO		
Wall 3 h	Wall Mount AGS3802B	PL PL PB PB	APN126DNR ABN111B	Without nameplate		
	Pole Mount AGS3802SB	(B)(B) (B)(B)	ABN111R	OFF		
Wall-Pole 4 holes	Wall Mount AGS4801B	P.P. P.P.	APN126DNR APN126DNG	Without nameplate Without nameplate		
Wall- 4 hc	Pole Mount AGS4801SB	PBPBABN111BPBPBABN111R		ON OFF		
	Wall Mount AGS5801B	PP PP	APN126DNR APN126DNG	Without nameplate Without nameplate		
Wall·Pole 5 holes	Pole Mount AGS5801SB	PBPB PBPB SSSS	ABN111B ABN111R ASN211N	ON OFF HAND-AUTO		
Wall 5 hc	Wall Mount AGSM5801B	AA P.B.B BB	(Note) AM ammeter APN126DNR ABN111B ABN111R	Without nameplate Without nameplate ON OFF		

Note: Specify the Part No. of the meter to select a required capacity.

3-colur	nn			Package Quantity: 1		
Control Station		Mounted Switches/Pilot Lights				
Style	Part No.	Symbol	Part No.	NA Nameplate Legend		
	Wall Mount AGS3901B	3901B @@@@ ABN111B		ON OFF		
Wall-Pole 3 holes	Pole Mount AGS3901SB	(PB(PB(PB)) (SS(SS)(SS))	ASN211N	HAND-AUTO		
Wall 3 h	Wall Mount AGS3902B	P.P.P. PB(PB(PB)	APN126DNR ABN111B	Without nameplate ON		
	Pole Mount AGS3902SB	BBB	ABN111R	OFF		
Wall-Pole 4 holes	Wall Mount AGS4901B	P.P.P. P.P.P.	APN126DNR APN126DNG	Without nameplate Without nameplate		
Wall 4 h	Pole Mount AGS4901SB	PBPBPB PBPBPB	ABN111B ABN111R	ON OFF		
	Wall Mount AGS5901B	PPP PPP	APN126DNR APN126DNG	Without nameplate Without nameplate		
Vall-Pole 5 holes	Pole Mount AGS5901SB	PBPB PBPB SSSSS	ABN111B ABN111R ASN211N	ON OFF HAND-AUTO		
Wall-Pole 5 holes	Wall Mount AGSM5901B	AAA	(Note) AM ammeter	Without nameplate		
	Pole Mount AGSM5901SB	P.P.P. PB PB PB PB PB PB	APN126DNR ABN111B ABN111R	Without nameplate ON OFF		

Note: Specify the Part No. of the meter to select a required capacity.

Ordering Information

When ordering control stations with switches/pilot lights:

Specify the Part No. of the control station.

When ordering enclosures without switches/pilot lights, specify the following items.

- 1. Part No. of the enclosure
- 2. Part No. and specifications of the switches/pilot lights to be mounted (lens color, button color, etc.)
- 3. Nameplate
- 4. Lead-in fitting


Only when ordering the gland hub for leading in cables, specify Part No. and the cable outside diameter (R).


5. Other specifications

Ordering Example


-	-			
1) ②		Part No. of Enclosur	е	AGS
34		Switch/Pilot Light and Nameplate	12	APN126DNR
56			34	APN126DNG
78			56	ABN210B, with NA-1
91			78	ABN201R, with NA-2
	•		910	ASN211N, with NA-32

Note: Any ø30 mm TWN/TWND series switches/pilot lights are selectable. Take into consideration the degree of protection of the switch/pilot light and the effective depth of the enclosure.

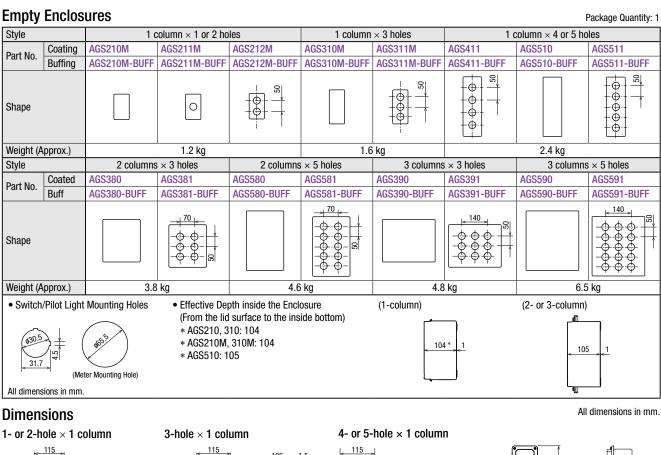




н



3 holes

1370




35

M4



10




M6

ø230

0200

Grounding terminal


4-ø14 mounting hole




1 hole

2 holes

1320






4/5 holes

1500

2.4 kg

8.0 kg

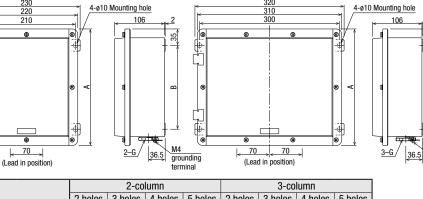

2-colum			lumn	mn 3-column					
		2 holes	3 holes	4 holes 5 holes 2 hole		2 holes	3 holes	4 holes	5 holes
	A	250		350		50		350	
	В	180		280		180		280	
H 1400		1500 1400		1500					
	G 3/4 (22 mm) 1 (28 mm)		3/4 (22 mm)		3/4 (2	2 mm)	1 (28	mm)	
Weight	Wall Mount	3.8	kg	4.6 kg		4.8	kg	6.5	kg
(Approx.)	Pole Mount	9.3	kg	10.4 kg		10.6	3 kg	12.2	2 kg

EP5128A AGS September 2023

Ordering Terms and Conditions

Thank you for using IDEC Products.

By purchasing products listed in our catalogs, datasheets, and the like (hereinafter referred to as "Catalogs") you agree to be bound by these terms and conditions. Please read and agree to the terms and conditions before placing your order.

1. Notes on contents of Catalogs

(1) Rated values, performance values, and specification values of IDEC products listed in this Catalog are values acquired under respective conditions in independent testing, and do not guarantee values gained in combined conditions.

Also, durability varies depending on the usage environment and usage conditions.

- (2) Reference data and reference values listed in Catalogs are for reference purposes only, and do not guarantee that the product will always operate appropriately in that range.
- (3) The specifications / appearance and accessories of IDEC products listed in Catalogs are subject to change or termination of sales without notice, for improvement or other reasons.
- (4) The content of Catalogs is subject to change without notice.

2. Note on applications

- (1) If using IDEC products in combination with other products, confirm the applicable laws / regulations and standards. Also, confirm that IDEC products are compatible with your systems, machines, devices, and the like by using under the actual conditions. IDEC shall bear no liability whatsoever regarding the compatibility with IDEC products.
- (2) The usage examples and application examples listed in Catalogs are for reference purposes only. Therefore, when introducing a product, confirm the performance and safety of the instruments, devices, and the like before use. Furthermore, regarding these examples, IDEC does not grant license to use IDEC products to you, and IDEC offers no warranties regarding the ownership of intellectual property rights or non-infringement upon the intellectual property rights of third parties.
- (3) When using IDEC products, be cautious when implementing the following.
 i. Use of IDEC products with sufficient allowance for rating and performance
 - ii. Safety design, including redundant design and malfunction prevention design that prevents other danger and damage even in the event that an IDEC product fails
 - iii. Wiring and installation that ensures the IDEC product used in your system, machine, device, or the like can perform and function according to its specifications
- (4) Continuing to use an IDEC product even after the performance has deteriorated can result in abnormal heat, smoke, fires, and the like due to insulation deterioration or the like. Perform periodic maintenance for IDEC products and the systems, machines, devices, and the like in which they are used.
- (5) IDEC products are developed and manufactured as general-purpose products for general industrial products. They are not intended for use in the following applications, and in the event that you use an IDEC product for these applications, unless otherwise agreed upon between you and IDEC, IDEC shall provide no guarantees whatsoever regarding IDEC products.
 - i. Use in applications that require a high degree of safety, including nuclear power control equipment, transportation equipment (railroads / airplanes / ships / vehicles / vehicle instruments, etc.), equipment for use in outer space, elevating equipment, medical instruments, safety devices, or any other equipment, instruments, or the like that could endanger life or human health
 - ii. Use in applications that require a high degree of reliability, such as provision systems for gas / waterworks / electricity, etc., systems that operate continuously for 24 hours, and settlement systems
 - iii. Use in applications where the product may be handled or used deviating from the specifications or conditions / environment listed in the Catalogs, such as equipment used outdoors or applications in environments subject to chemical pollution or electromagnetic interference If you would like to use IDEC products in the above applications, be sure to consult with an IDEC sales representative.

3. Inspections

We ask that you implement inspections for IDEC products you purchase without delay, as well as thoroughly keep in mind management/maintenance regarding handling of the product before and during the inspection.

4. Warranty

(1) Warranty period

The warranty period for IDEC products shall be one (1) year after purchase or delivery to the specified location. However, this shall not apply in cases where there is a different specification in the Catalogs or there is another agreement in place between you and IDEC.

(2) Warranty scope

Should a failure occur in an IDEC product during the above warranty period for reasons attributable to IDEC, then IDEC shall replace or repair that product, free of charge, at the purchase location / delivery location of the product, or an IDEC service base. However, failures caused by the following reasons shall be deemed outside the scope of this warranty.

- i. The product was handled or used deviating from the conditions / environment listed in the Catalogs
- ii. The failure was caused by reasons other than an IDEC product
- iii. Modification or repair was performed by a party other than IDEC
- iv. The failure was caused by a software program of a party other than $\ensuremath{\mathsf{IDEC}}$
- v. The product was used outside of its original purpose
- vi. Replacement of maintenance parts, installation of accessories, or the like was not performed properly in accordance with the user's manual and Catalogs

vii. The failure could not have been predicted with the scientific and technical standards at the time when the product was shipped from $\ensuremath{\mathsf{IDEC}}$

viii. The failure was due to other causes not attributable to IDEC (including cases of force majeure such as natural disasters and other disasters)

Furthermore, the warranty described here refers to a warranty on the IDEC product as a unit, and damages induced by the failure of an IDEC product are excluded from this warranty.

5. Limitation of liability

The warranty listed in this Agreement is the full and complete warranty for IDEC products, and IDEC shall bear no liability whatsoever regarding special damages, indirect damages, incidental damages, or passive damages that occurred due to an IDEC product.

6. Service scope

The prices of IDEC products do not include the cost of services, such as dispatching technicians. Therefore, separate fees are required in the following cases.

- Instructions for installation / adjustment and accompaniment at test operation (including creating application software and testing operation, etc.)
- (2) Maintenance inspections, adjustments, and repairs
- (3) Technical instructions and technical training
- (4) Product tests or inspections specified by you

The above content assumes transactions and usage within your region. Please consult with an IDEC sales representative regarding transactions and usage outside of your region. Also, IDEC provides no guarantees whatsoever regarding IDEC products sold outside your region.

IDEC CORPORATION

Head Office 6-64, Nishi-Miyahara-2-Chome, Yodogawa-ku, Osaka 532-0004, Japan

USA	IDEC Corporation	Singapore	IDEC Izumi Asia Pte. Ltd.
EMEA	APEM SAS	Thailand	IDEC Asia (Thailand) Co., Ltd.
		India	IDEC Controls India Private Ltd.

Specifications and other descriptions in this brochure are subject to change without notice.

2023 IDEC Corporation, All Rights Reserved.

ChinaIDEC (Shanghai) Corporation
IDEC Izumi (H.K.) Co., Ltd.TaiwanIDEC Taiwan Corporation



Japan IDEC Corporation

